

Power Quality Analysis of Grid-Connected Photovoltaic System with Adjustable Speed Drives
Makbul Anwaril¹, Muhammad Ikram Mohd Rashid² and Taufik³
¹ Faculty of Electrical Engineering, University of Technology Malaysia, Johor, Malaysia
(Tel : +607-5535235; E-mail: Makbul@fke.utm.my)
² Faculty of Electrical and Electronic Engineering, Universiti Malaysia Pahang, Pahang,
Malaysia
(Tel : +609-4242153; E-mail: Mikram@ump.edu.my)
³ Department of Electrical Engineering, California Polytechnic State University, US
(Tel : + 805-756-2318; E-mail: taufik@calpoly.edu)
Abstract: This paper presents power quality analysis of a distributed generation system
consisting of Photovoltaic (PV) - Inverter system as the renewable source connected to a
network of Adjustable Speed Drives (ASDs) as the load. A small-scale laboratory consists of
Photovoltaic, Inverter, ASDs and loads system was setup. Two power supplies from PV and grid
were connected to two ASDs which powered two separate induction motors. Load of motor 1 was
fixed while load of motor 2 was varied. In the experiment, both energy supplies from the grid
and photovoltaic system were connected to the loads. Measurements have been done at both side
of power transformer to analyze power quality in the system.
Keywords: Grid-connected PV, Adjustable Speed Drives, Power Quality.

1. INTRODUCTION

Renewable energy is no longer just an option nowadays. The renewable energy plays an important role in our live due to rise demand for electrical power. Photovoltaic is one of the renewable energy that has been used for about decade ago [1]. Photovoltaic or known as solar energy is a renewable resource that is vast and is locally available. It is a clean energy source that allows for local energy independence. The sun's energy flow reaching the earth is typically about 1,000 Watts per square meter (W/m²), although ease of use varies with location and time of year [2].

Photovoltaic produce DC voltage to the load. The voltage can be converting to AC by using DC-AC converter which is commonly known as inverter. The inverter conversion process with power electronics is generally known as the switched mode inversion. One major application of switched-mode is Adjustable Speed Drive (ASD) [3]. ASD is an electronic device that controls the rotational speed of motor-driven equipment such as fans, pumps, and compressors. By ensuring that the motor's speed is accurately matched to the load placed on the motor, an ASD helps to save energy. Speed control is achieved by adjusting the frequency of the voltage applied to the motor. That why they also called ASDs as Variable Frequency Drives (VFDs). ASD is becoming a significant load component for power distribution systems. However, there are some cons to ASD systems, mainly the harmonics created by the power electronic components in the ASD. Harmonics are created by the switching system of the power electronic circuit inside the drive and can cause damage to power equipment on the utility side and sensitive loads on the customer side.

Because of this, the Institute of Electrical and Electronic Engineers (IEEE) has developed standards for the amount of harmonic distortion a customer's load can inject back into the utility lines. To conform to this relatively new established guideline, it is a common practice nowadays for VFD systems to have line filters installed before them to reduce distortion caused by the VFDs back to the line. Doing so will therefore maintain a degree of power quality at the distribution level. More importantly, these line filters will also prevent the harmonic distortion to propagate back and further up at the transmission level [4].

The effects of harmonics on voltage stability of power systems and how adjustable speed drives affect these harmonics have been studied [5]. In the network of Adjustable Speed Drives, connection from Adjustable Speed Drive and induction motors can be used to analyze power quality impact to the grid system. Additionally, to reduce the higher total harmonic distortion in power system with a network of adjustable speed drives can be determine based on worst case operating scenarios [6].

This paper also comprises that addresses several issues related to the effect of ASDs on distribution systems: 1) the influence of harmonics on the increased power, and 2) the influence of harmonics on the motor load in voltage stability studies. In this paper, Photovoltaic connected to grid is used as power supply to the load. ASD as load to this system, two motor are used as real load and connected to two ASD as controller. A laboratory setup was established to perform the measurement. Data obtained from power quality of PV Inverter -Adjustable Speed Drive System study would provide the preliminary understanding on how to determine and identify optimum operating condition based on the worst and best case operating scenarios.

2. LABORATORY SETUP

The experimental setup of this research consists of two power supplies. The first source of energy supply to the drive was from the grid – transformer system. The second source of energy supply to the drive was from the photovoltaic – inverter system. Those two power supplies were connected to two adjustable speed drives of 0.5 hp and 1.5 hp. Each of adjustable speed drives (ASD) powered two separate induction motors. 0.5 hp ASD powered 0.25 hp induction motor that was referred as motor 1 whereas 1.5 hp ASD powered 2 hp induction motor that was referred as motor 2. Load of motor 1 was fixed at 25% torque and load of motor 2 was varied for 0% to ? 50% torque.

In this research project, there were two types of experiment that have been carried out. Figure 1 shows the block diagram of laboratory setup. They are simplified diagram of the system indicating the labeling convention of the data and graphs. All experiments were conducted under room temperature. Figure 1 shows energy supply from grid and photovoltaic system has been used:

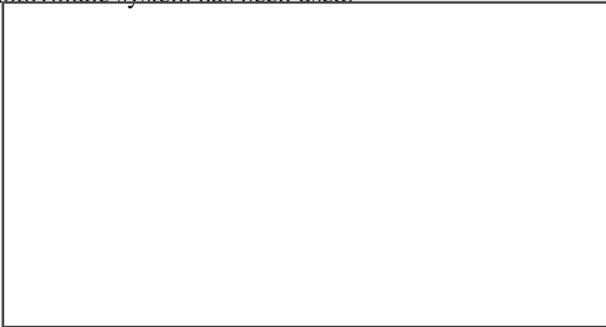


Fig. 1. Experimental setup; PV Inverter system with adjustable speed drives are connected to grid.

The experiment that was carried out in the laboratory is shown in Figure 1 in which used both energy supplies from grid and photovoltaic system were connected to the loads. Measurements were recorded at both side of power transformer at point C, and D to analyze power quality in these systems. Figure 2 shows the laboratory setup for the measurement.

In conducting the experiment, frequency of the system and load motor 2 (Carpanelli) were varied from 40Hz to 70Hz and 0 to ? 50% of load whereas load motor 1 (Feedback) was fixed at 25% of load. Each time data collection was completed, the data was compiled into graphs to monitor the difference of harmonics distortion based on location and percentage of the rated load.

Table 1 lists the equipments that have been installed in the laboratory:



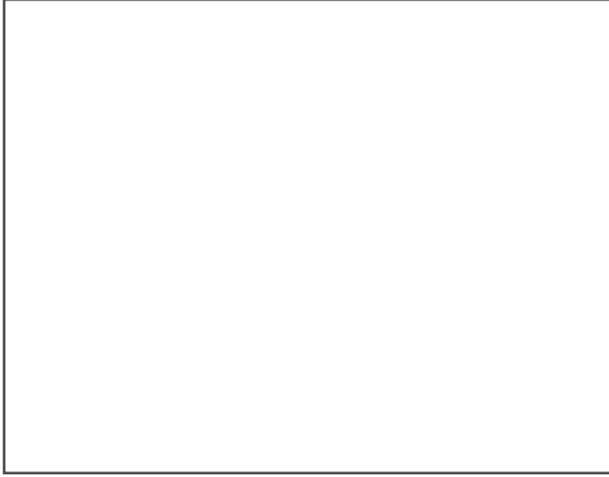


Fig 2. Laboratory setup.

3. RESULTS AND DISCUSSION

Figures 3 to 14 show trends in THD_v and THD_i for different M2 torque load percentages at both side power transformer which in point C for primary and D for secondary.

A. Analysis of Voltage Distortion

In this experiment, THD_v for PV-grid connection is shown in graphs as in figure 3, 5, 7, 9, 11, and 13. THD_v value for PV- grid connection is higher than THD_v grid connection for all different frequency. This evidence is shown in THD_v graphs for this experiment when compare to previous experiment. This phenomenon happened when photovoltaic system was implementing in grid system.

B. Analysis of Current Distortion

The THD_i for PV-grid connection is shown in figure 4, 6, 8, 10, 12, and 14. THD_i value with respect to PV-grid connection is higher and not consistence rather than THD_i for grid connection for all different frequency. This evidence is shown in THD_i graphs of this experiment when compared to previous experiment. This phenomenon happened when photovoltaic system was implemented in grid system. The highest THD_i or worst case happened when the real power in this system nearly changed the polarity from positive to negative or negative to positive. The negative and positive real power indicates energy supply from PV and grid, respectively. The lowest THD_i which is the best case happened when smaller negative value of real power was recorded. Since PV produced smaller negative value compared to grid, it can be concluded that supply from PV has smallest THD_i.



Fig. 3. THD_v vs M2 torque load at point C for M1 at 25% of rated torque.



Fig. 4. THDi vs M2 torque load at point C for M1 at 25% of rated torque.

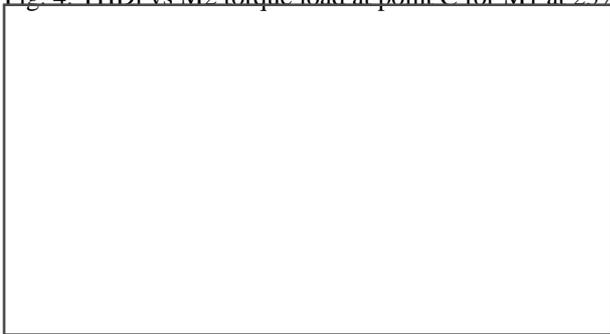


Fig. 5. THDv vs M2 torque load at point D for M1 at 25% of rated torque.



Fig. 6. THDi vs M2 torque load at point D for M1 at 25% of rated torque.



Fig. 7. THD_v vs M2 torque load at point C for M1 at 25% of rated torque.

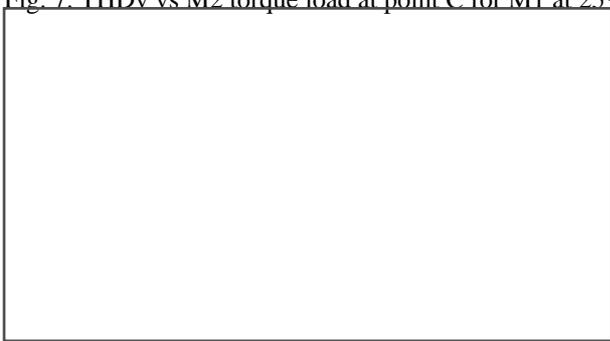


Fig. 8. THD_i vs M2 torque load at point C for M1 at 25% of rated torque.



Fig. 9. THD_v vs M2 torque load at point D for M1 at 25% of rated torque.

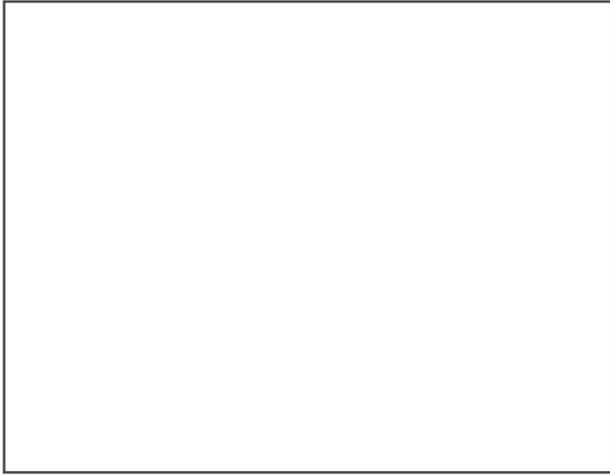


Fig. 10. THDi vs M2 torque load at point D for M1 at 25% of rated torque.



Fig. 11. THDv vs M2 torque load at point C for M1 at 25% of rated torque.

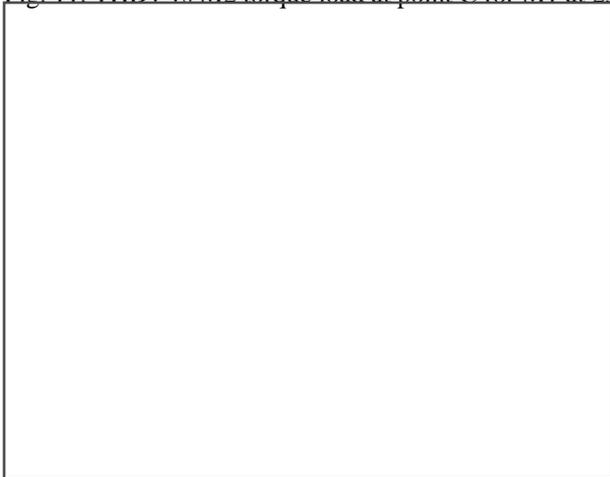


Fig. 12. THDi vs M2 torque load at point C for M1 at 25% of rated torque.



Fig. 13. THDv vs M2 torque load at point D for M1 at 25% of rated torque.

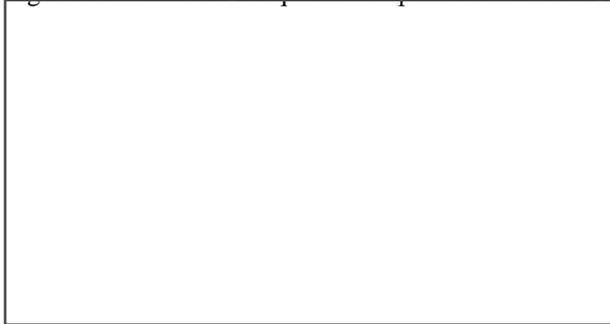


Fig. 14. THDi vs M2 torque load at point D for M1 at 25% of rated torque.

4. CONCLUSIONS

The analysis of the data shows trends in the harmonics behavior in the grid-connected photovoltaic system with adjustable speed drives as loads and can be used to analyze power quality in a system with similar components and setup. Optimum operation condition based on the worst and best case operating scenarios was determined and identify.

Worst case in this project was determined and identified when the system had to change the energy supply from PV to grid. At condition when system nearly changes the supply, THDi has the higher value. On the other hand, the best case happened when energy supply from PV is strongly used rather than grid.

5. REFERENCES

- 1] C. Mitsui, S. Tu, Taufik, and M. Anwari, "Efficiency study of adjustable speed drive with dual motor connection," Proc. IEEE International Power Engineering Conference (IPEC), 2007.
- 2] Taufik, Erin Matsumoto, Makbul Anwari, "Impact of multiple adjustable speed drive system to power system harmonics" Proc. 2nd IEEE International Conference on Power and Energy(PECon 08), December, 2008.
- 3] F. Jurado, N. Acero, A. López, J. I. Rojas, "Adjustable speed drives and voltage stability", Proc. International electric machines and drives conference 2001, pp. 522-527.
- 4] R. Foster, "Photovoltaic markets and applications", Southwest Technology Development Institute, New Mexico State University, March 15, 2007.
- 5] F.L. Albuquerque, A.J. Moraes, G. C. Guimarães, S. M. R.Sanhueza, A.R. Vaz, "Optimization of a photovoltaic system connected to electric power grid", Proc. IEEE/PES Transmission & Distribution Conference & Exposition: Latin America, 2004, pp. 645-650.
- 6] Makbul Anwari, M. I. M. Rashid, M. Imran Hamid, Taufik, "Experimental Harmonic Analysis of a Network of Adjustable Speed Drives", TENCON November 2009.